



WEST SIDE - 69.73 & 79TH FLOORS

SCALE IN FEET

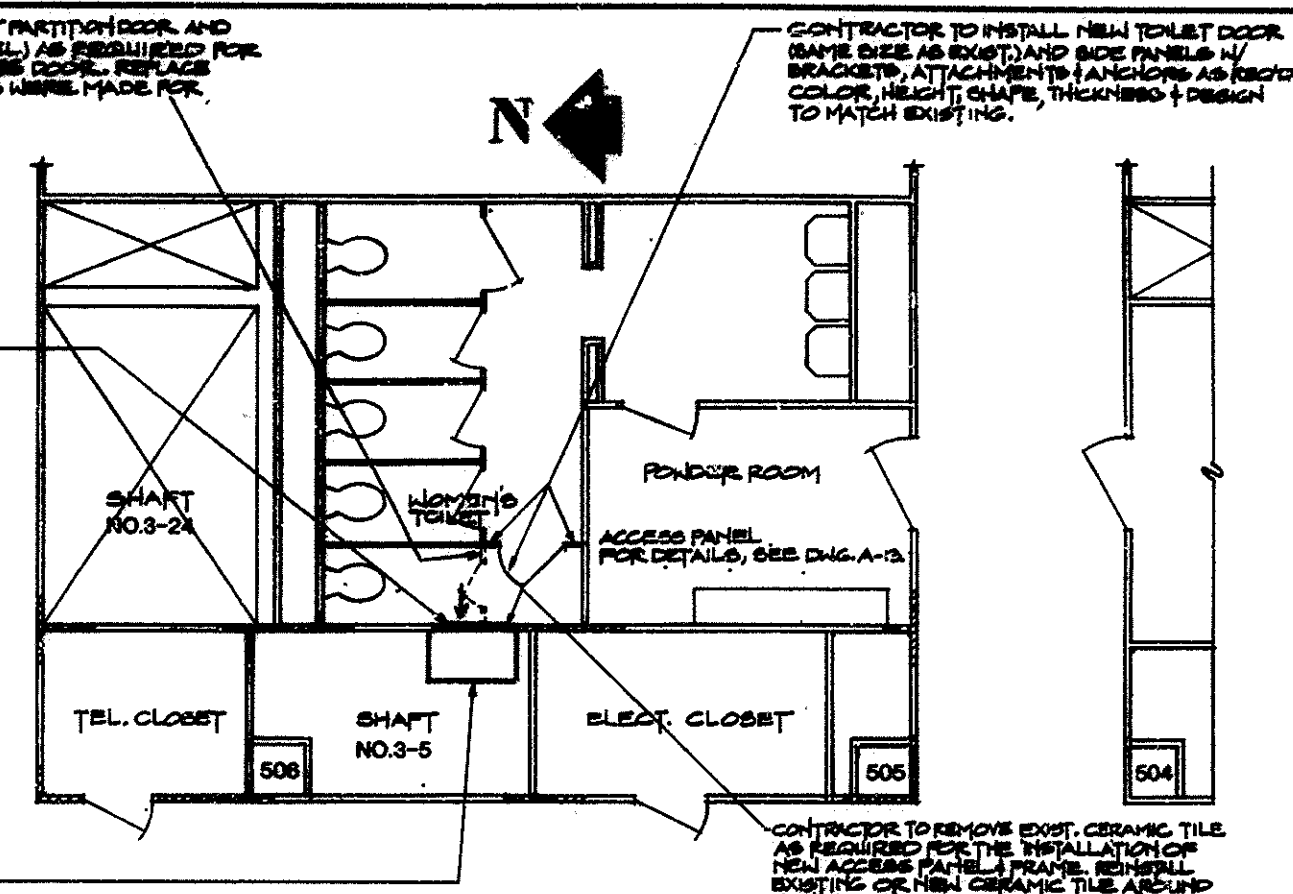

WEST SIDE - 83RD FLOOR


SCALE IN FEET

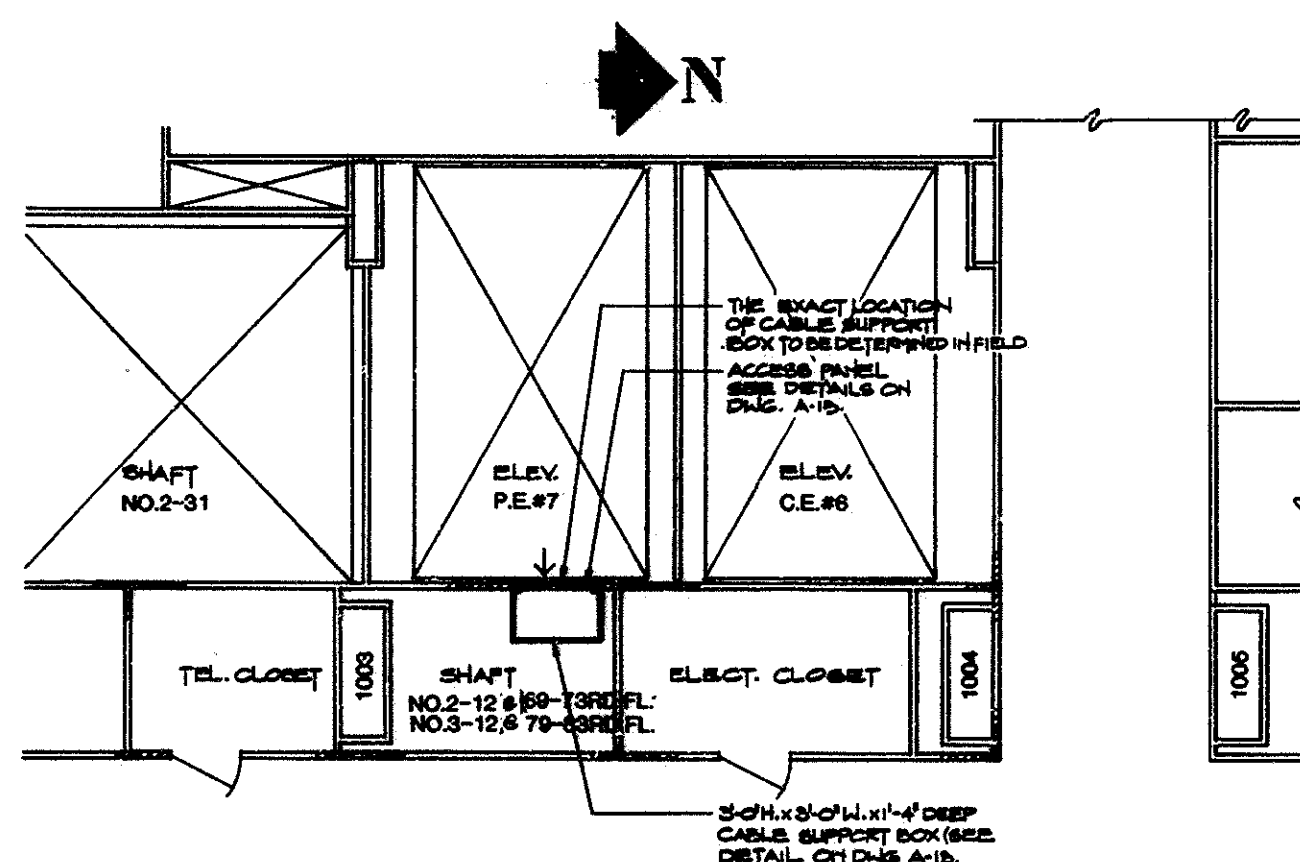

EAST SIDE - 69.73, 79 & 83RD FLOORS

SCALE IN FEET

NOTE: FOR SECTION & DETAIL OF CABLE SUPPORT BOX SEE DWG. # A-13

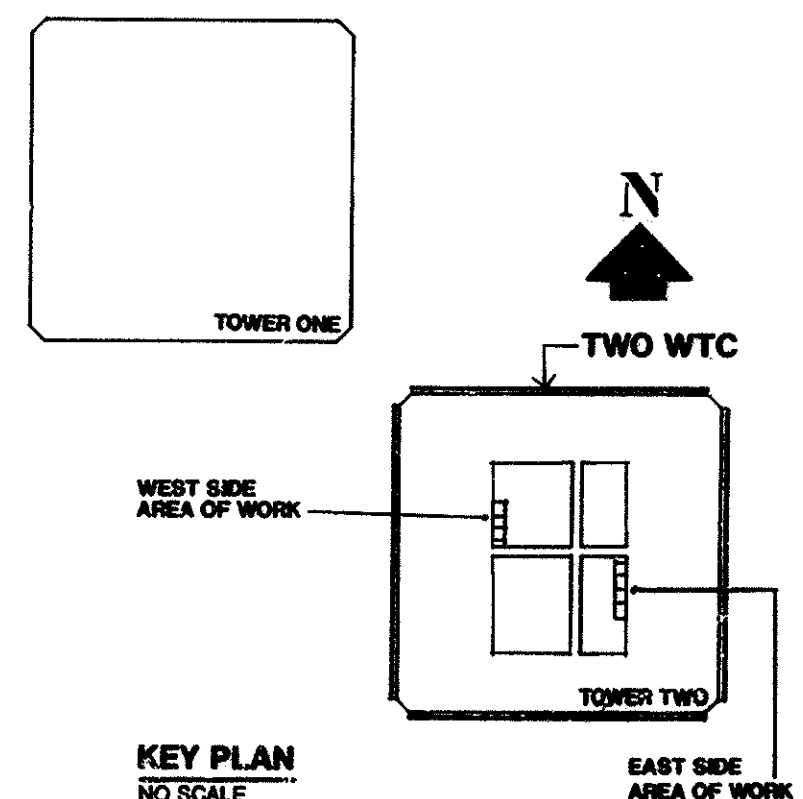

Sheet 17 of 41

THE PORT AUTHORITY OF NY & NJ

Engineering Program Manager



3/1/91 Drawings of Record

Engineering Department Design Division

The World Trade Center Electrical/HVAC Upgrade Program

LOW VOLTAGE DISTRIBUTION
TWO WTC
ARCHITECTURAL
69.73, 79 & 83RD FLOORS
WEST & EAST SIDE
CABLE SUPPORT BOX LOCATIONS

This drawing subject to conditions in contract. All inventions, ideas, designs and methods herein are reserved to Port Authority and may not be used without its written consent.

S.C.&M.S. S.C.&S.P.P.
Designed by Drawn by Checked by

Date 10-4-93 Scale AS NOTED

Contract Number Drawing Number
WTC-804.041 A-14